



ROOF PLAN - POWER
SCALE: 1/16" = 1'-0"

DRAWING NOTES:


1. MOUNT ROOFTOP RECEPTACLE ON OR ADJACENT TO UNIT MINIMUM 18" ABOVE ROOF. CONNECT RECEPTACLE TO NEAREST EXISTING UNSWITCHED CORRIDOR OR STORAGE ROOM 120V RECEPTACLE CIRCUIT ACCORDINGLY.
2. REFER TO KITCHEN EXHAUST HOOD WIRING DIAGRAM ON DRAWING E-10 FOR CIRCUITING REQUIREMENTS.
3. PROVIDE 120V WIRING CONNECTION TO UNIT FOR UV LIGHTS, BI-POLAR IONIZATION, ETC.

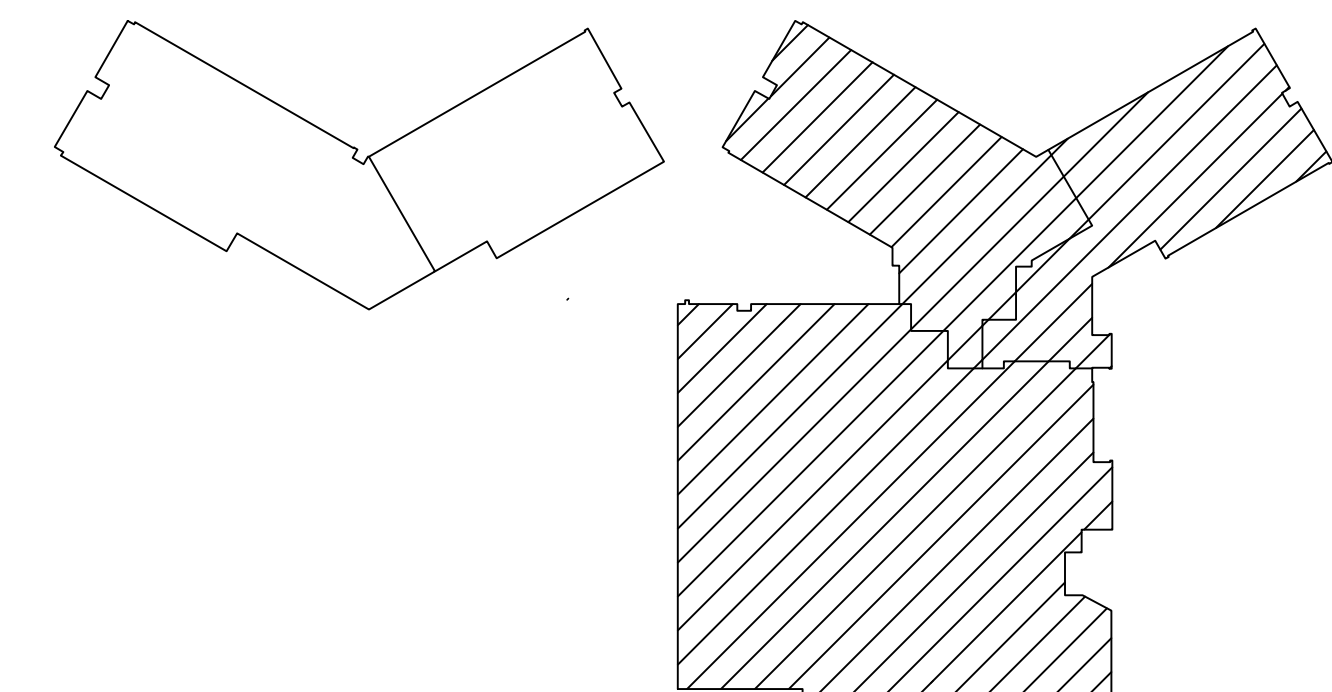

KEY PLAN
NO SCALE

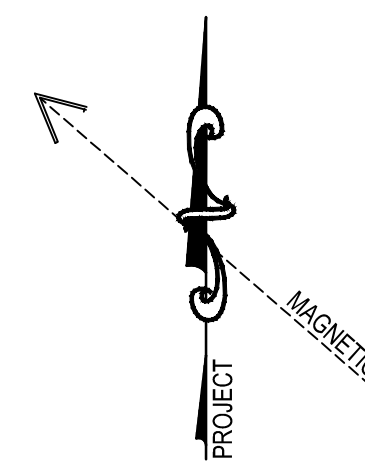

CONSOLIDATED
ENGINEERS
1022 James Drive
Leesport, PA 17033
Tel: 610-916-1600 Fax: 610-916-1610
Internet: www.consolidatedengineers.com

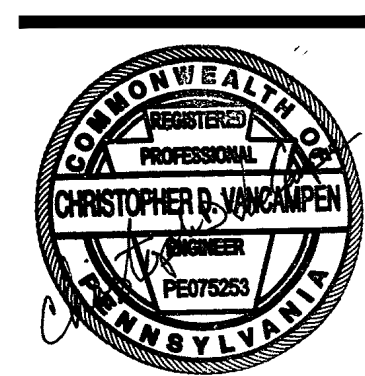

AEM ARCHITECTS, INC.
3700 PERKIO MEN AVENUE, READING, PA 19608-2795
Phone: 610-793-3620 Fax: 610-793-3622
www.aemarch.com

ROOF PLAN - POWER
RENOVATIONS TO THE
REAMSTOWN ELEMENTARY SCHOOL
COCALICO SCHOOL DISTRICT
SOUTH REAMSTOWN ROAD, REAMSTOWN, PENNSYLVANIA, LANCASTER COUNTY, PA

ALL DIMENSIONS AND EXISTING CONDITIONS
SHALL BE CHECKED AND VERIFIED
BY THE CONTRACTOR AT THE SITE.
JOB NO.: 22011.00
DRAWN BY: DS
DATE: 04.14.23