

DIFFUSER KEY

QUANTITY	SYMBOL	SEE LEGEND	NECK SIZE	CFM	TYPE
(2)	LCD	- 12" DIA. -	50 - A		
		OR 12"x12"			

LEGEND

SR = SUPPLY REGISTER	A = TUTTLE & BAILEY MODEL AGITAIR RC
CD = CEILING DIFFUSER	B = TUTTLE & BAILEY MODEL CRE500 W/TUTLE & BAILEY MODEL A45 MOUNTING FRAME
RR = RETURN REGISTER	C = TUTTLE & BAILEY MODEL T75D 1/2" SPACING
ER = EXHAUST REGISTER	
LCD = LAY-IN CEILING DIFFUSER	
LRR = LAY-IN RETURN REGISTER	

DIFFUSERS AND REGISTERS TYPES

NEW WORK - HVAC


SCALE: 1/4" = 1'-0"

GENERAL DEMOLITION NOTES:

- MECHANICAL (2) CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER DISPOSAL OF ALL PLUMBING RELATED EQUIPMENT, FIXTURES, PIPING, PIPING ACCESSORIES, ETC. REMOVED DURING DEMO WORK.
- MECHANICAL (2) CONTRACTOR SHALL COORDINATE ALL DEMOLITION WORK WITH THAT OF OTHER TRADES.

DEMOLITION NOTES

- REMOVE EXISTING SUPPLY GRILLE AT THE FLEX DUCT CONNECTION. DISPOSE OF GRILLE AS NECESSARY. RETAIN FLEX DUCTWORK FOR RECONNECTION TO NEW GRILLE.
- REMOVE EXISTING RETURN / TRANSFER GRILLE.
- REMOVE EXISTING RETURN AIR DUCTWORK AND RETURN AIR GRILLE.
- REMOVE EXISTING GAS FURNACE INCLUDING FLUE AND COMBUSTION AIR PVC PIPING. TURN OFF GAS AND DISCONNECT GAS PIPING AT NEAREST THREADED FITTING OR UNION. PROTECT GAS PIPING TO REMAIN FOR RECONNECTION TO NEW GAS FIRED FURNACE. EXISTING SUPPLY AIR DUCT RISER TO REMAIN FOR RECONNECTION TO NEW FURNACE.

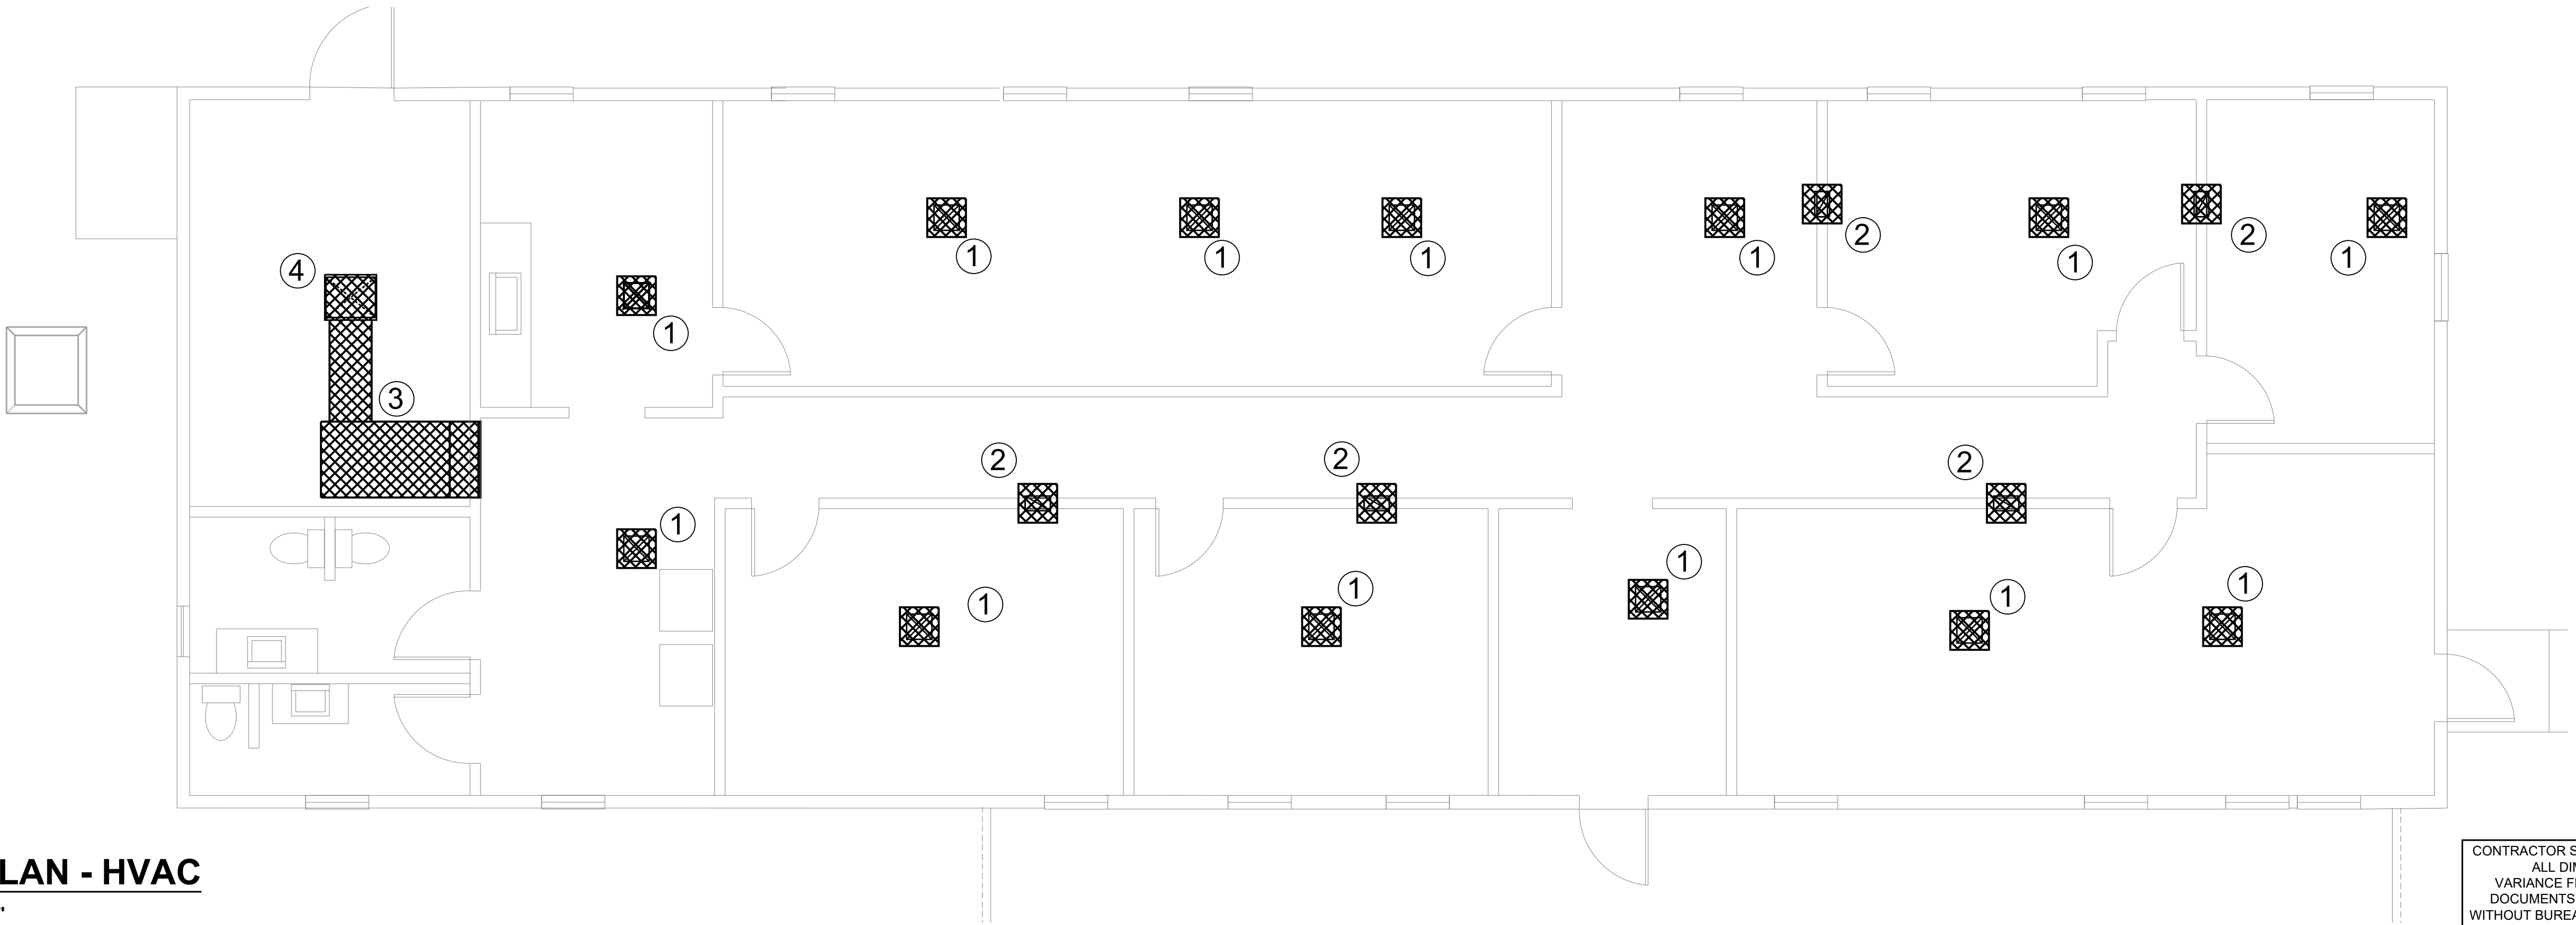

DEMO PLAN - HVAC

SCALE: 1/4" = 1'-0"

NO.	DESCRIPTION	DATE
REVISIONS		
COMMONWEALTH OF PENNSYLVANIA DEPARTMENT OF MILITARY AND VETERANS AFFAIRS BUREAU OF DESIGN AND PROJECT MANAGEMENT BLDG. 0-10 FORT INDIANTOWN GAP ANNVILLE, LEBANON COUNTY, PA 17003		
DMVA PROJECT NO.: 42220110		
BUILDING RENOVATION BUILDING 4-19, SERVICE ROAD, FTIG ANNVILLE, LEBANON COUNTY, PA 17003		
HVAC PLANS		
DRAWN BY: B. TOEVS	DATE: 18 APR. 2023	DRAWING NO. H.1.1
CHECKED BY:	SCALE: AS SHOWN	



CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS.
VARIANCE FROM CONTRACT DOCUMENTS NOT PERMITTED WITHOUT BUREAU OF ENGINEERING AND ARCHITECTURE APPROVAL.