


GENERAL NOTES

- 1. PROVIDE DDC CONTROL PANEL FOR EQUIPMENT INDICATED.
- 2. PROVIDE VOLUME CONTROL DAMPER ON ALL SUPPLY AND RETURN BRANCH DUCTWORK.


KEYNOTES

- 1 DDC CONTROL PANEL TO SERVE AHU'S
- 2 DDC CONTROL PANEL TO SERVE HOT WATER SYSTEM
- 3 PROVIDE FIRE DAMPER W/ ASSOCIATED DUCT ACCESS DOOR AT SLAB PENETRATION. (TYPICAL FOR ALL FIRE DAMPERS IN THIS AREA)
- 4 PROVIDE BUILDING DDC CONTROL PANEL.
- 5 PROVIDE REMOTE DAMPER CONTROL ACCESS AS INDICATED. SEE M-504 FOR MORE INFORMATION.
- 6 PROVIDE VOLUME CONTROL DAMPER.

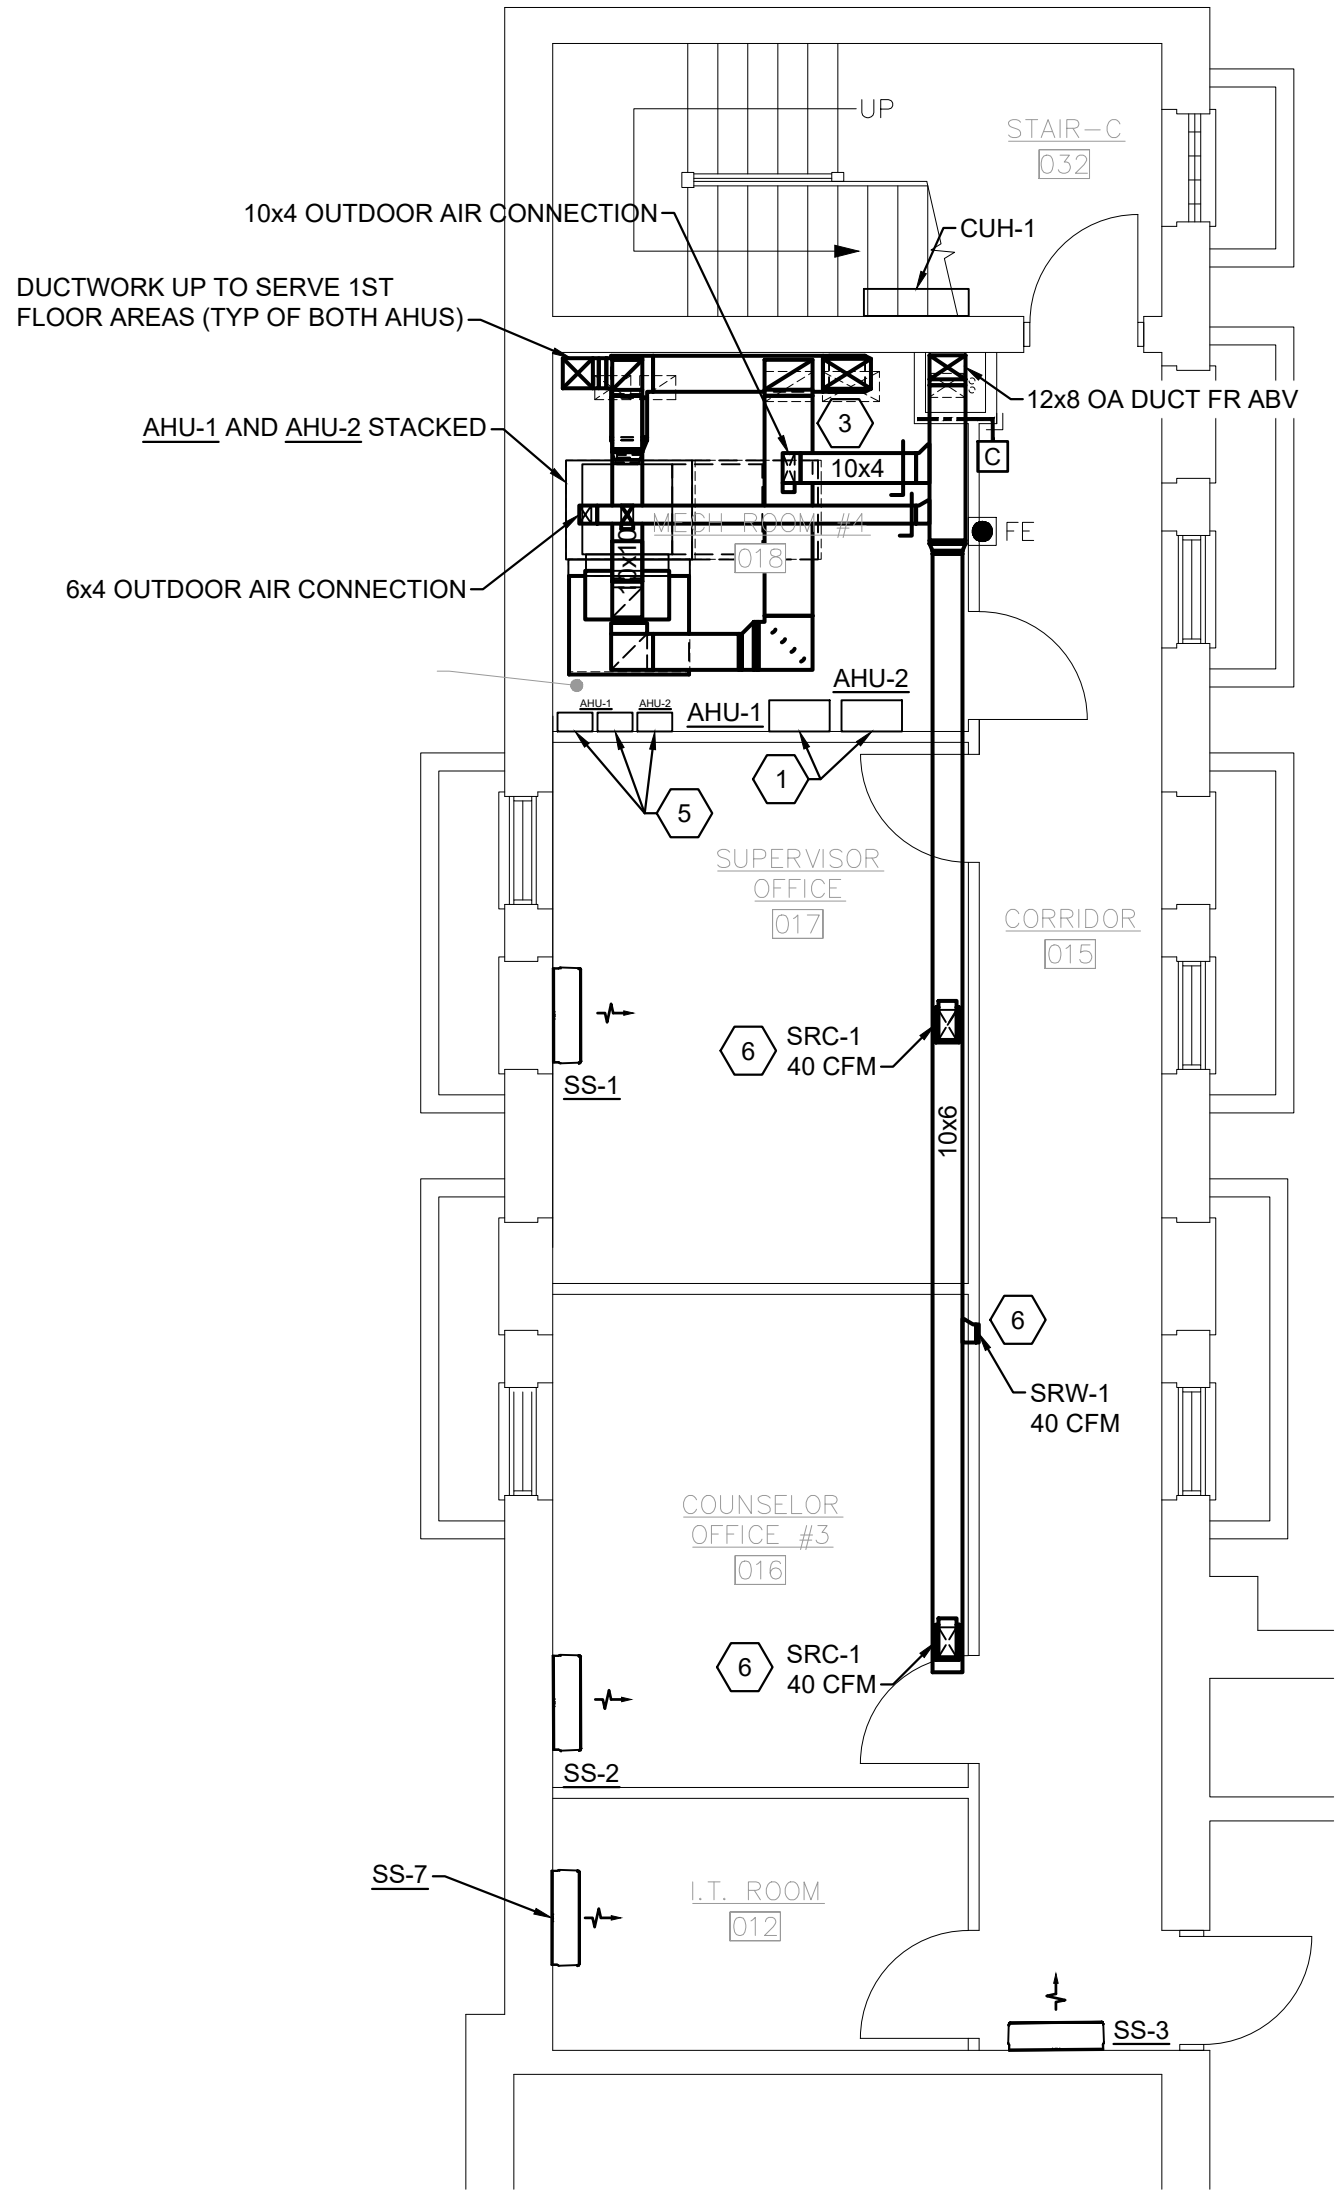

BASEMENT PLAN - NEW WORK - BASE BID 2 - MECHANICAL

Scale: 3/16" = 1'-0"

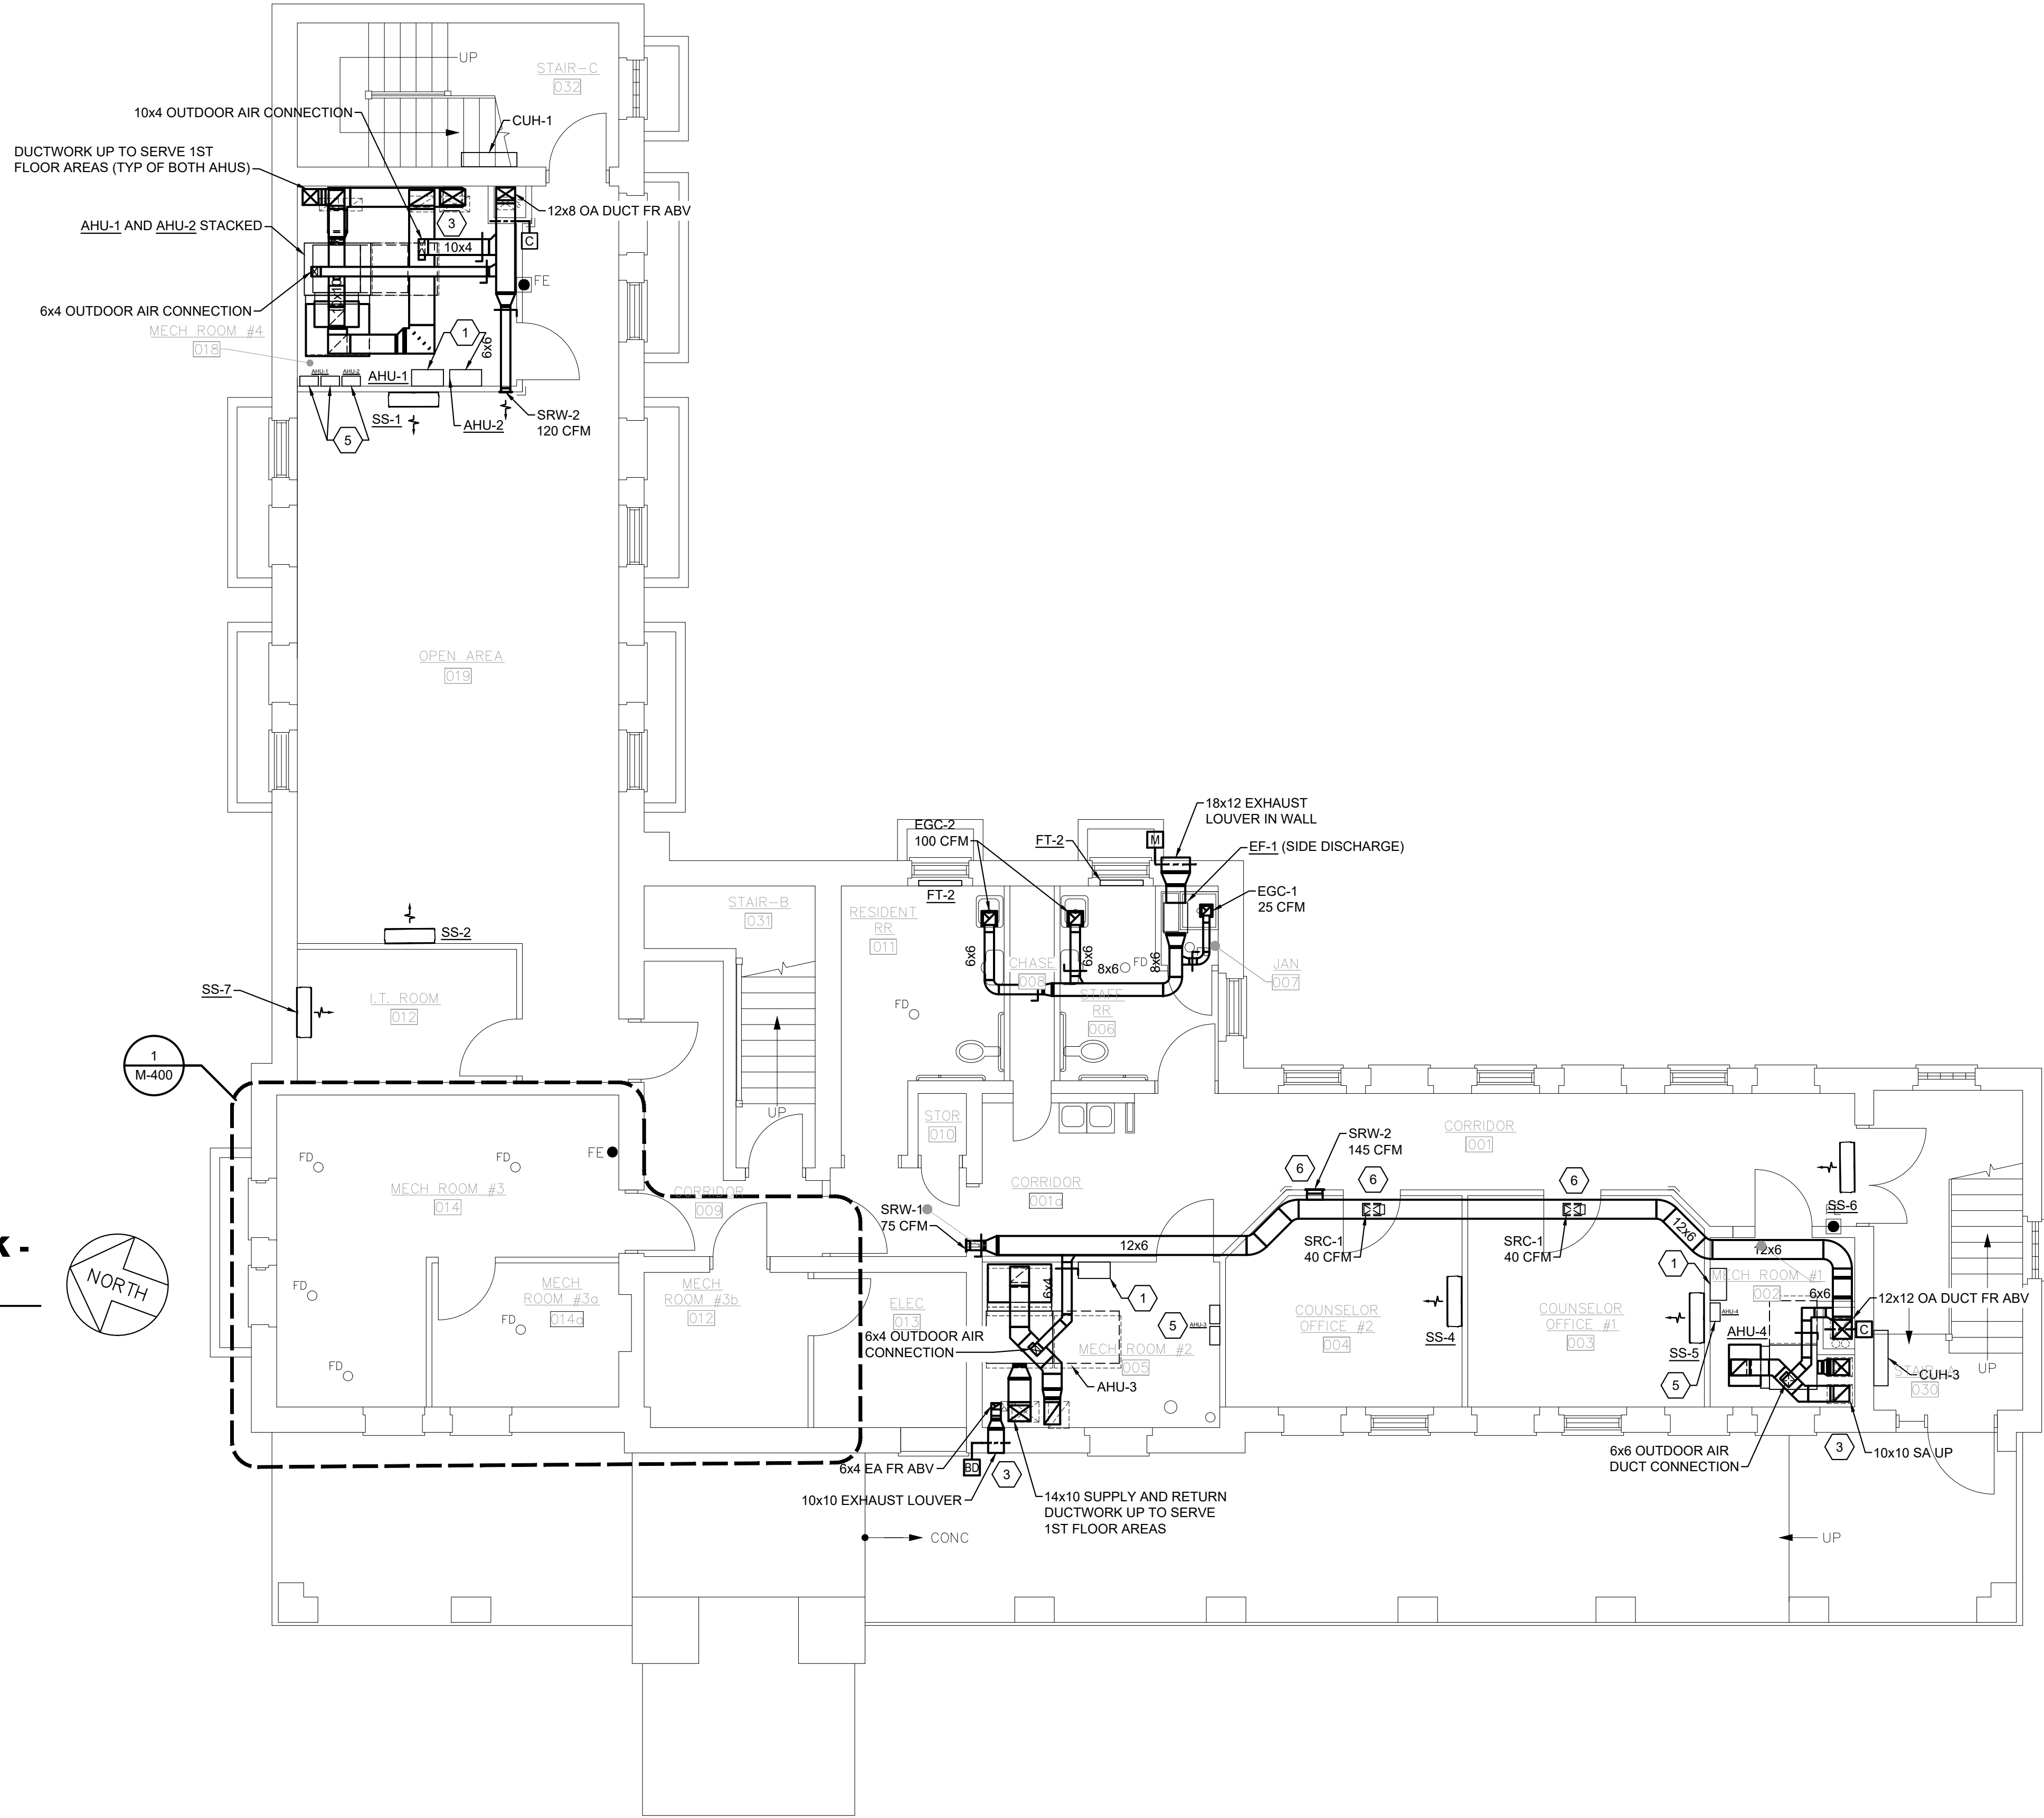

BASEMENT PLAN - NEW WORK - BASE BID 1 - MECHANICAL

Scale: 3/16" = 1'-0"

RECORD REVISIONS			
PROFESSIONAL'S SIGNATURE DATE			
UpStreet ARCHITECTS, INC. 541 PHILADELPHIA ST. 911 MENOHER BLVD. INDIANA, PA 15701 JOHNSTOWN, PA 15905			
COMMONWEALTH OF PENNSYLVANIA DEPARTMENT OF GENERAL SERVICES HARRISBURG, PENNSYLVANIA			
D.G.S. PROJECT No. C-0588-0015 PHASE 1			
LOYSVILLE YOUTH DEVELOPMENT CENTER- RENOVATIONS TO ZIMMERMAN-BINGAMAN (ZB) COTTAGE DEPARTMENT OF HUMAN SERVICES LOYSVILLE, TYRONE TOWNSHIP, PERRY COUNTY, PA			
BASEMENT PLAN - NEW WORK - MECHANICAL			
VERIFY SCALE BAR IS ONE (1) INCH LONG ON ORIGINAL DRAWING: 0 1 IF BAR IS NOT ONE (1) INCH LONG, ADJUST SCALE ACCORDINGLY		CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS. VARIANCE FROM CONTRACT DOCUMENTS NOT PERMITTED WITHOUT PROFESSIONAL & BUREAU OF CONSTRUCTION APPROVAL.	DRAWN BY W. MINAHAN CHECKED BY T. HOVAN DATE 27 JUNE 2023 SCALE AS NOTED SHEET No. M-200