


GENERAL NOTES

1. ALL ITEMS TO BE CONSIDERED BB#1 UNLESS NOTED OR SHOWN OTHERWISE.
2. ALL PIPING SHALL BE ROUTED AS HIGH AS POSSIBLE UNLESS INDICATED OTHERWISE.
3. ALL REFRIGERANT PIPING INDICATED AS SINGLE LINE FOR CLARITY. FINAL REFRIGERANT PIPING QUANTITY, SIZE AND DESIGN SHALL BE PER MANUFACTURERS RECOMMENDATION.

KEYNOTES

- 1 3/4" HWS&R PIPING UP TO FIRST FLOOR UNLESS OTHERWISE NOTED.
- 2 3/4" HWS&R PIPING CONNECTING TO CABINET UNIT HEATER LOCATED UNDERNEATH STAIRS. REFER TO 3-WAY PIPING DETAIL FOR ADDITIONAL INFORMATION.
- 3 ROUTE ALL REFRIGERANT PIPING IN ARCHITECTURAL BULKHEAD ACROSS CORRIDOR. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.

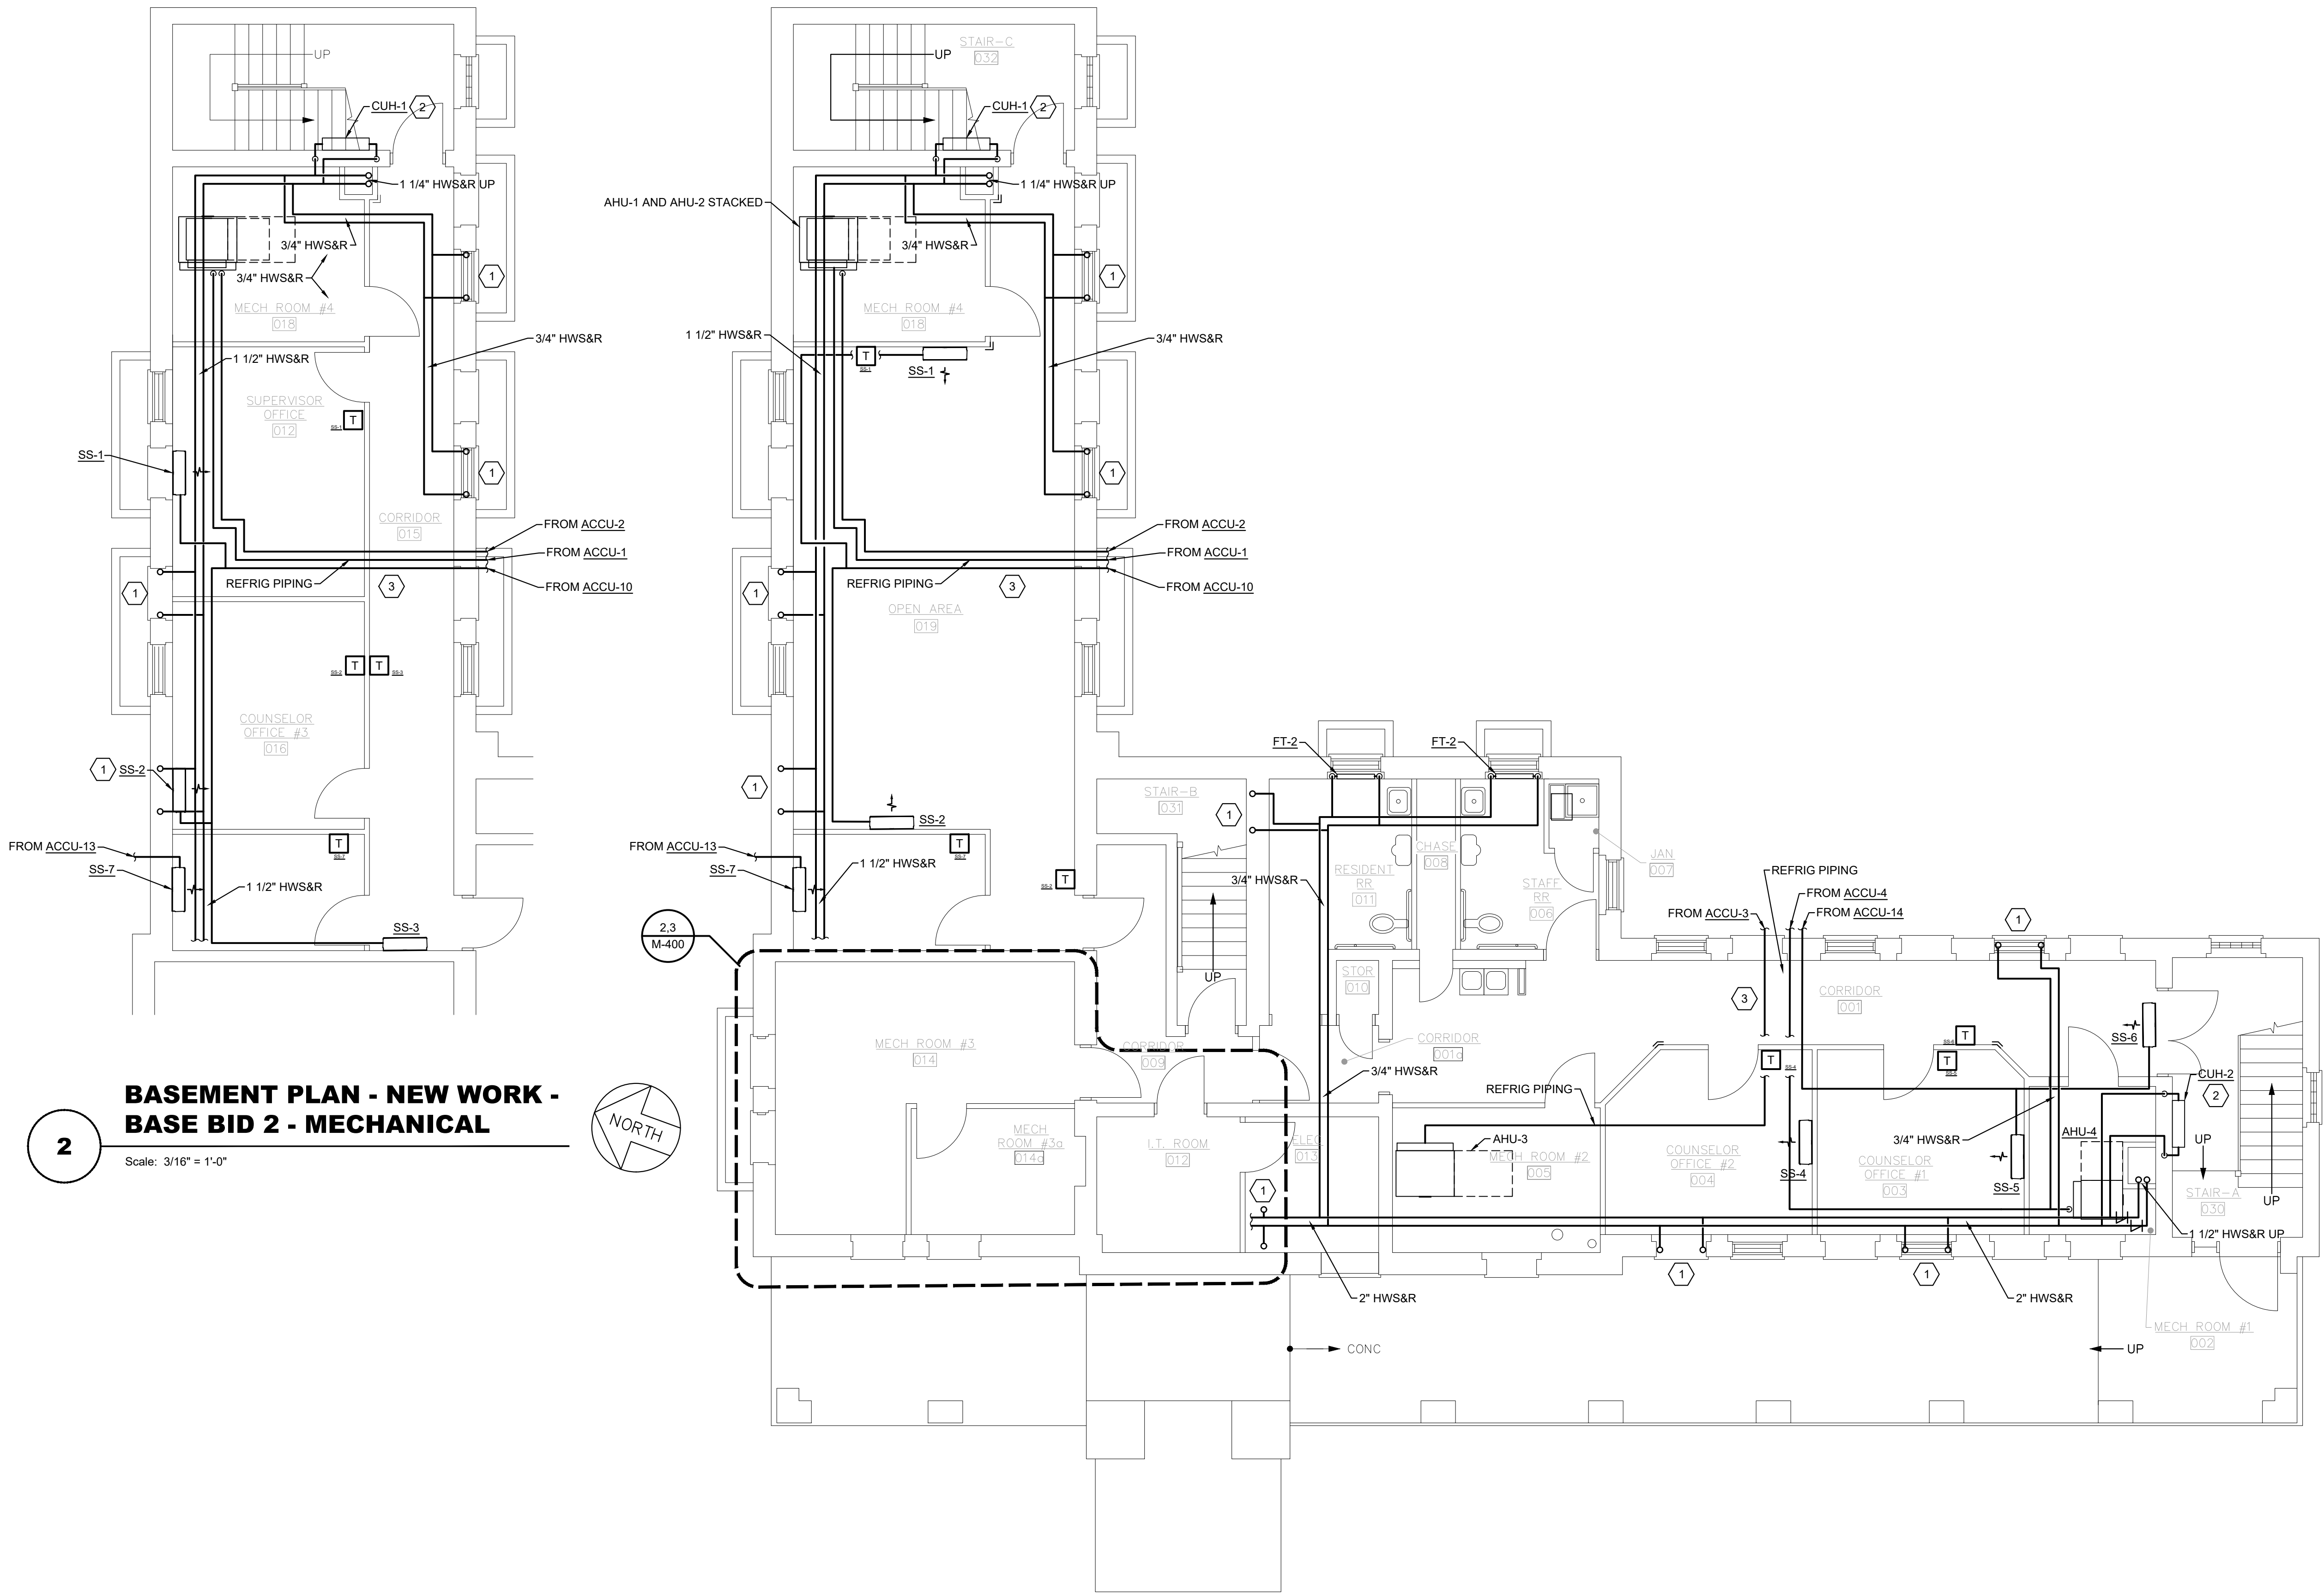


BASEMENT PLAN - NEW WORK -
BASE BID 2 - MECHANICAL

Scale: 3/16" = 1'-0"

BASEMENT PLAN - NEW WORK - MECHANICAL

Scale: 3/16" = 1'-0"

RECORD REVISIONS



PROFESSIONAL'S SIGNATURE DATE

UpStreet ARCHITECTS, INC.
541 PHILADELPHIA ST. 911 MENOHER BLVD.
INDIANA, PA 15701 JOHNSTOWN, PA 15905

COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF GENERAL SERVICES
HARRISBURG, PENNSYLVANIA

D.G.S. PROJECT No. **C-0588-0015 PHASE 1**

**LOYSVILLE YOUTH DEVELOPMENT CENTER-
RENOVATIONS TO ZIMMERMAN-
BINGAMAN (ZB) COTTAGE**
DEPARTMENT OF HUMAN SERVICES
LOYSVILLE, TYRONE TOWNSHIP, PERRY COUNTY, PA

BASEMENT PLAN - NEW WORK - MECHANICAL

VERIFY SCALE

BAR IS ONE (1) INCH LONG
ON ORIGINAL DRAWING:
0 1

IF BAR IS NOT ONE (1) INCH LONG,
ADJUST SCALE ACCORDINGLY

CONTRACTOR SHALL FIELD VERIFY
ALL DIMENSIONS
VARIANCE FROM CONTRACT
DOCUMENTS NOT PERMITTED
WITHOUT PROFESSIONAL & BUREAU
OF CONSTRUCTION APPROVAL.

DRAWN BY
W. MINAHAN
CHECKED BY
T. HOVAN

DATE
27 JUNE 2023
SCALE
AS NOTED

SHEET No.

M-300