


A TYPICAL SPRINKLER ZONE CONTROL & TEST VALVE ASSEMBLY
NOT TO SCALE

NOTES:

- ALL ITEMS TO BE CONSIDERED B881 UNLESS NOTED OTHERWISE.
- REFER TO FP-001 FOR FIRE SUPPRESSION SYMBOLS, ABBREVIATIONS, NOTES AND DETAILS (TYPICAL).
- THE BUILDING SHALL BE FULLY PROTECTED WITH AN AUTOMATIC FIRE SPRINKLER SYSTEM IN ACCORDANCE WITH THE APPLICABLE CONSTRUCTION CODES, NFPA STANDARDS AND THE FACILITY'S INSURANCE CARRIER REQUIREMENTS. FIRE SPRINKLERS ARE SHOWN FOR BID PURPOSES ONLY. (TYPICAL)
- BASEMENT FLOOR AREA: (WET) FIRE SPRINKLER 2856 SF ±
- THE FIRE SUPPRESSION SYSTEM SHALL BE HYDRAULICALLY CALCULATED, DESIGNED SIZES AND SIZED IN ACCORDANCE WITH NFPA 13.
- APPROVED INSTITUTIONAL ANTI-LIGATURE TYPE FIRE SPRINKLER HEADS WILL BE FURNISHED AND INSTALLED IN ALL OCCUPIED AND ACCESSIBLE AREAS THROUGHOUT THE FACILITY UNLESS OTHERWISE NOTED AND SCHEDULED. REFER TO SPRINKLER SCHEDULE ON FP-001.

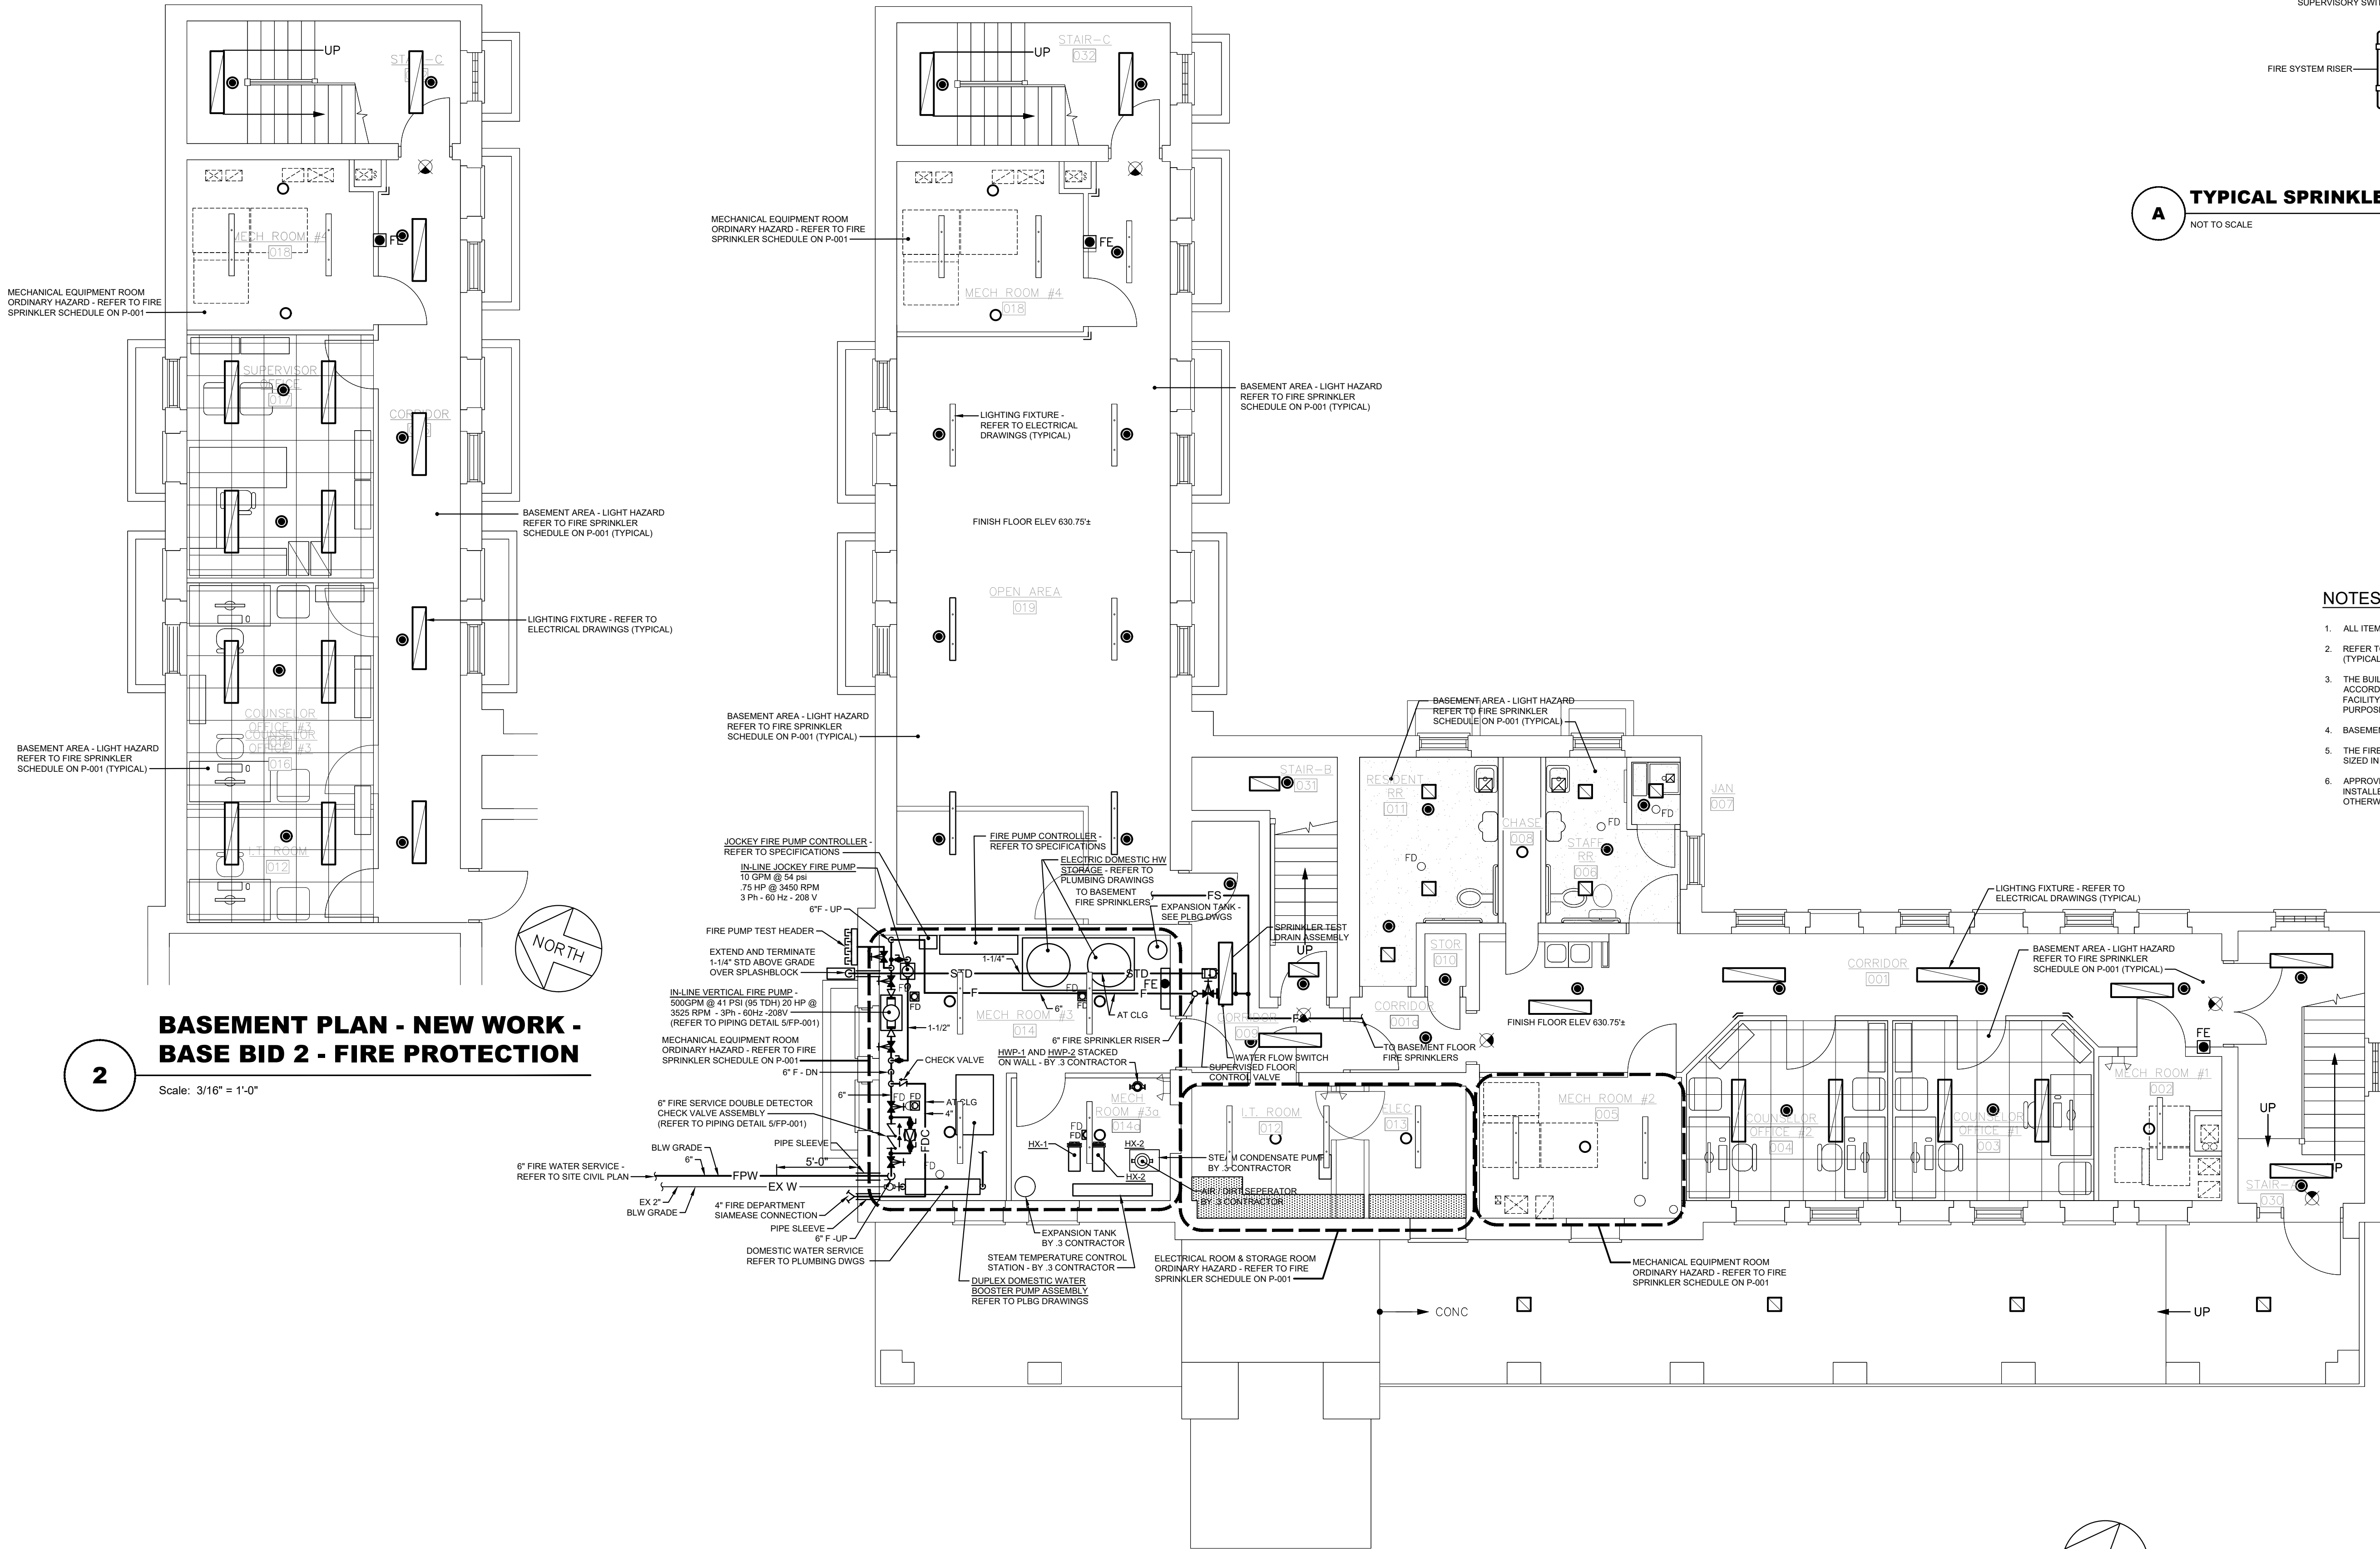

2 BASEMENT PLAN - NEW WORK - BASE BID 2 - FIRE PROTECTION
Scale: 3/16" = 1'-0"

1 BASEMENT PLAN - NEW WORK - BASE BID 1 - FIRE PROTECTION
Scale: 3/16" = 1'-0"

RECORD REVISIONS			
PROFESSIONAL'S SIGNATURE DATE			
UpStreet ARCHITECTS, INC. 541 PHILADELPHIA ST. 911 MENOHER BLVD. INDIANA, PA 15701 JOHNSTOWN, PA 15905			
COMMONWEALTH OF PENNSYLVANIA DEPARTMENT OF GENERAL SERVICES HARRISBURG, PENNSYLVANIA			
D.G.S. PROJECT No. C-0588-0015 PHASE 1			
LOYSVILLE YOUTH DEVELOPMENT CENTER- RENOVATIONS TO ZIMMERMAN-BINGAMAN (ZB) COTTAGE DEPARTMENT OF HUMAN SERVICES LOYSVILLE, TYRONE TOWNSHIP, PERRY COUNTY, PA			
BASEMENT PLAN - NEW WORK - FIRE			
VERIFY SCALE BAR IS ONE (1) INCH LONG ON ORIGINAL DRAWING: 0 1 IF BAR IS NOT ONE (1) INCH LONG, ADJUST SCALE ACCORDINGLY	DRAWN BY S. KORMANIK DATE 27 JUNE 2023 SHEET No. FP-200		
	CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS. VARIANCE FROM CONTRACT DOCUMENTS NOT PERMITTED WITHOUT PROFESSIONAL & BUREAU OF CONSTRUCTION APPROVAL. CHECKED BY W. MINAHAN SCALE AS NOTED		