

SCALE 1/4" = 1'-0" CONCOURSE - AREA 'C' - DINING CAFETERIA 61E - FIRE PROTECTION PLAN - RENOVATION 02

GENERAL NOTES

- KEY NOTES BELOW REFER TO .3 PLUMBING/FIRE PROTECTION RENOVATION WORK IN CAFETERIA 61E.
- REFER TO DETAIL 02/FP213 FOR KEY NOTE LOCATIONS FOR .3 PLUMBING/FIRE PROTECTION RENOVATION WORK.
- FOR .3 PLUMBING/FIRE PROTECTION DEMOLITION WORK, REFER TO DETAIL 01K/FP213 FOR KEY NOTES AND DETAIL 01/FP213 FOR KEY NOTE LOCATIONS.
- COORDINATE ALL RENOVATION WORK WITH THE .1 GENERAL CONTRACTOR.

KEY NOTES FOR .3 FIRE PROTECTION CONTRACT


FOR THE DURATION OF THE CONSTRUCTION ACTIVITIES, THE .1 GENERAL CONTRACTOR SHALL PRESERVE AND PROTECT ALL EXISTING CONDITIONS TO REMAIN AND SHALL ENSURE THE BUILDING'S OCCUPANTS MAY SAFELY USE SPACES IN THE AREAS OF THE BUILDING NOT BEING RENOVATED.

KEY NOTES FOR .3 FIRE PROTECTION CONTRACT

(FP1) EXISTING SPRINKLER HEAD TO REMAIN.

(FP1) EXISTING SPRINKLER HEAD TO BE DEMOLISHED OR SALVAGED AND RELOCATED. REFER TO DETAILS 02K/P-FP213 AND 02/P-FP213 FOR ADDITIONAL INFORMATION.

SCALE NONE NOTES FOR FIRE PROTECTION RENOVATION WORK 02K

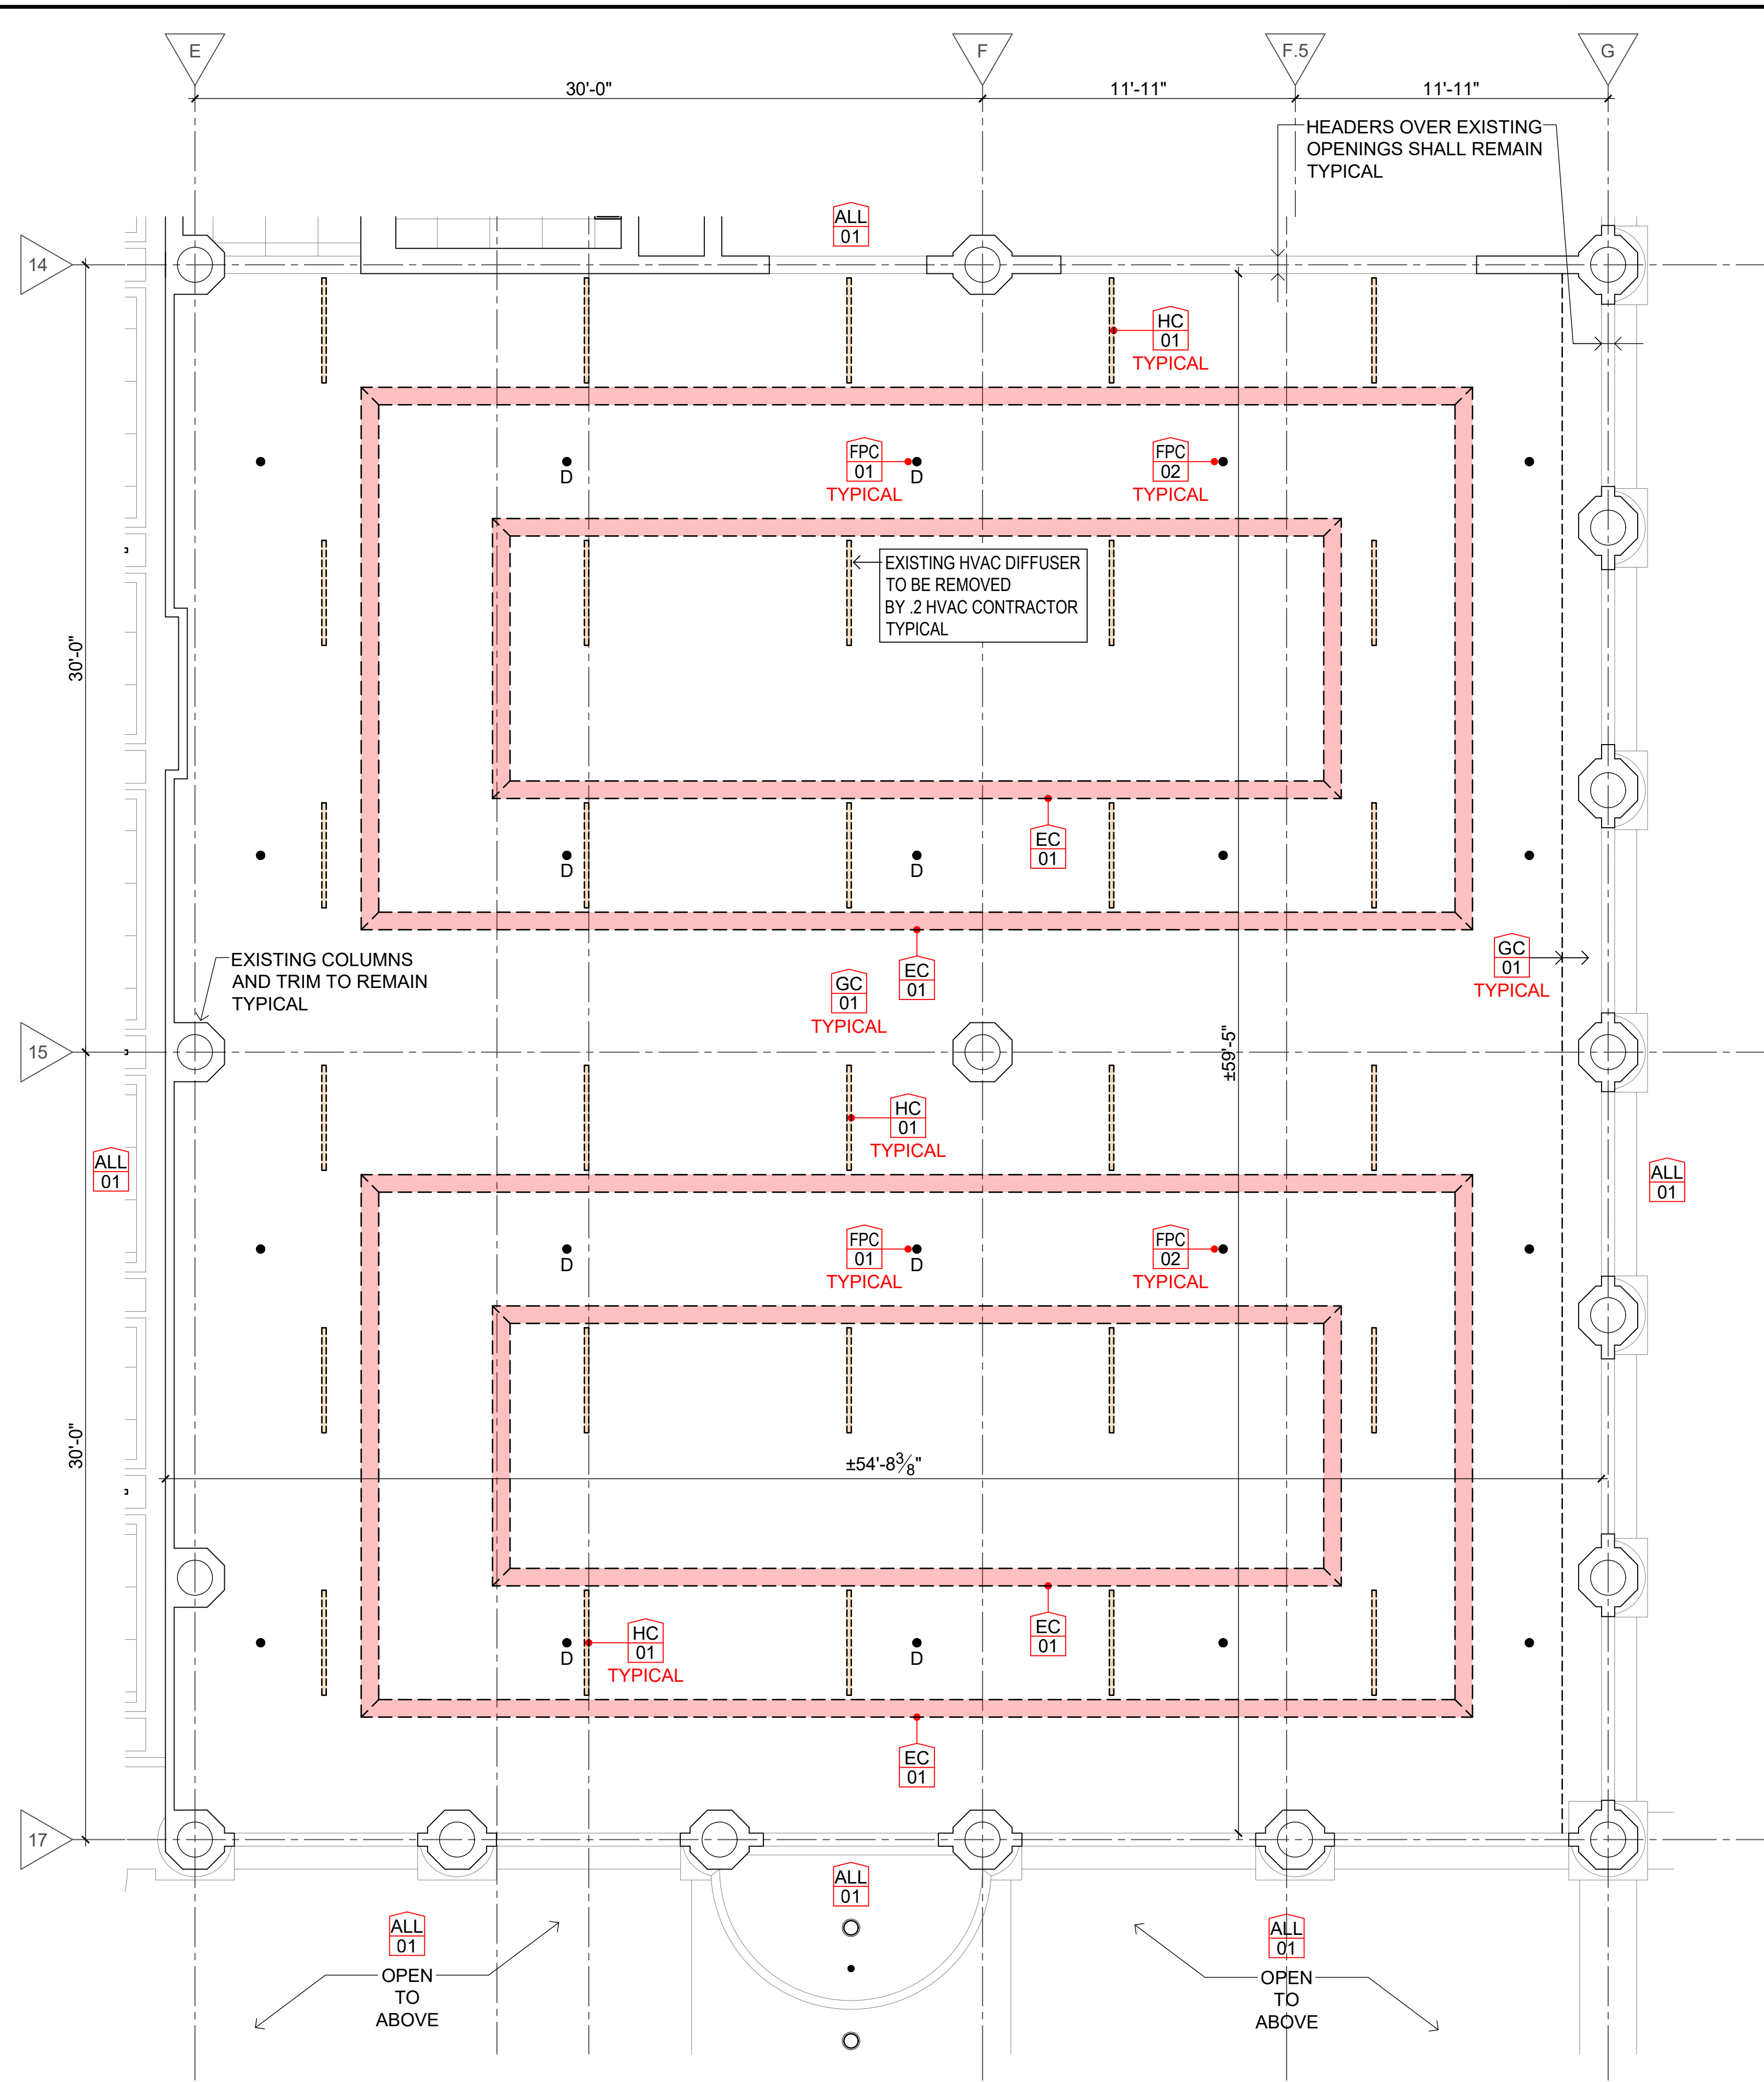

SCALE 1/4" = 1'-0" CONCOURSE - AREA 'C' - DINING CAFETERIA 61E - FIRE PROTECTION PLAN - DEMOLITION 01

GENERAL NOTES

- KEY NOTES BELOW REFER TO .3 PLUMBING/FIRE PROTECTION DEMOLITION WORK IN CAFETERIA 61E.
- REFER TO DETAIL 01/FP213 FOR KEY NOTE LOCATIONS FOR .3 PLUMBING/FIRE PROTECTION DEMOLITION WORK.
- FOR .3 PLUMBING/FIRE PROTECTION RENOVATION WORK, REFER TO DETAIL 02K/FP213 FOR KEY NOTES AND DETAIL 02/FP213 FOR KEY NOTE LOCATIONS.
- COORDINATE ALL DEMOLITION WORK WITH THE .1 GENERAL CONTRACTOR.

INFORMATIONAL KEY NOTES

FOR THE DURATION OF THE CONSTRUCTION ACTIVITIES, THE .1 GENERAL CONTRACTOR SHALL PRESERVE AND PROTECT ALL EXISTING CONDITIONS TO REMAIN AND SHALL ENSURE THE BUILDING'S OCCUPANTS MAY SAFELY USE SPACES IN THE AREAS OF THE BUILDING NOT BEING RENOVATED.

(SC 01) .1 GENERAL CONSTRUCTION CONTRACTOR SHALL REMOVE EXISTING SUSPENDED CEILING AND GWB BULKHEADS FROM THE DINING CAFETERIA. REFER TO DRAWINGS A303Cd AND A303cR FOR ADDITIONAL INFORMATION.

(HC 01) EXISTING DIFFUSERS TO BE REMOVED BY .2 MECHANICAL/HVAC CONTRACTOR.

(EC 01) EXISTING LIGHT FIXTURES TO BE REMOVED BY .4 ELECTRICAL CONTRACTOR.

KEY NOTES FOR .3 FIRE PROTECTION CONTRACT

(FPC 01) EXISTING SPRINKLER HEAD TO REMAIN.


(FPC 02) EXISTING SPRINKLER HEAD TO BE SALVAGED AND RELOCATED TO COORDINATE WITH LOCATIONS OF NEW SUSPENDED CEILING PANELS. REFER TO DETAIL 02/P-FP213 AND DRAWING A303Cr (ARCHITECTURAL REFLECTED CEILING PLAN) FOR NEW LOCATIONS FOR EXISTING SPRINKLER HEADS.

SCALE NONE NOTES FOR FIRE PROTECTION DEMOLITION WORK 01K

- EXISTING SCHEDULE 40 BLACK STEEL SPRINKLER PIPE TO REMAIN
- EXISTING SCHEDULE 40 BLACK STEEL SPRINKLER PIPE TO BE REMOVED
- NEW SCHEDULE 40 BLACK STEEL SPRINKLER PIPE TO BE PROVIDED
- EXISTING SPRINKLER HEAD TO REMAIN
- (D) EXISTING SPRINKLER HEAD TO BE REMOVED
- (N) NEW SPRINKLER HEAD TO BE PROVIDED (MATCH EXISTING)
- CONNECT NEW PIPE TO EXISTING PIPE

SCALE NONE FIRE PROTECTION LEGEND 00

SCALE & DIMENSIONS	BASE BIDS
BAR IS ONE (1) INCH LONG ON THIS DRAWING 0 1 IF BAR IS NOT ONE (1) INCH LONG, ADJUST SCALE ACCORDINGLY. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS. VARIANCE FROM CONTRACT NOT PERMITTED WITHOUT BUREAU OF ENGINEERING AND ARCHITECTURE APPROVAL.	ALL WORK SHOWN ON THIS DRAWING IS INCLUDED IN BASE BID 01, UNLESS NOTED OTHERWISE ON THIS DRAWING. REFER TO PROJECT MANUAL FOR FULL DESCRIPTION OF ALL BASE BIDS.

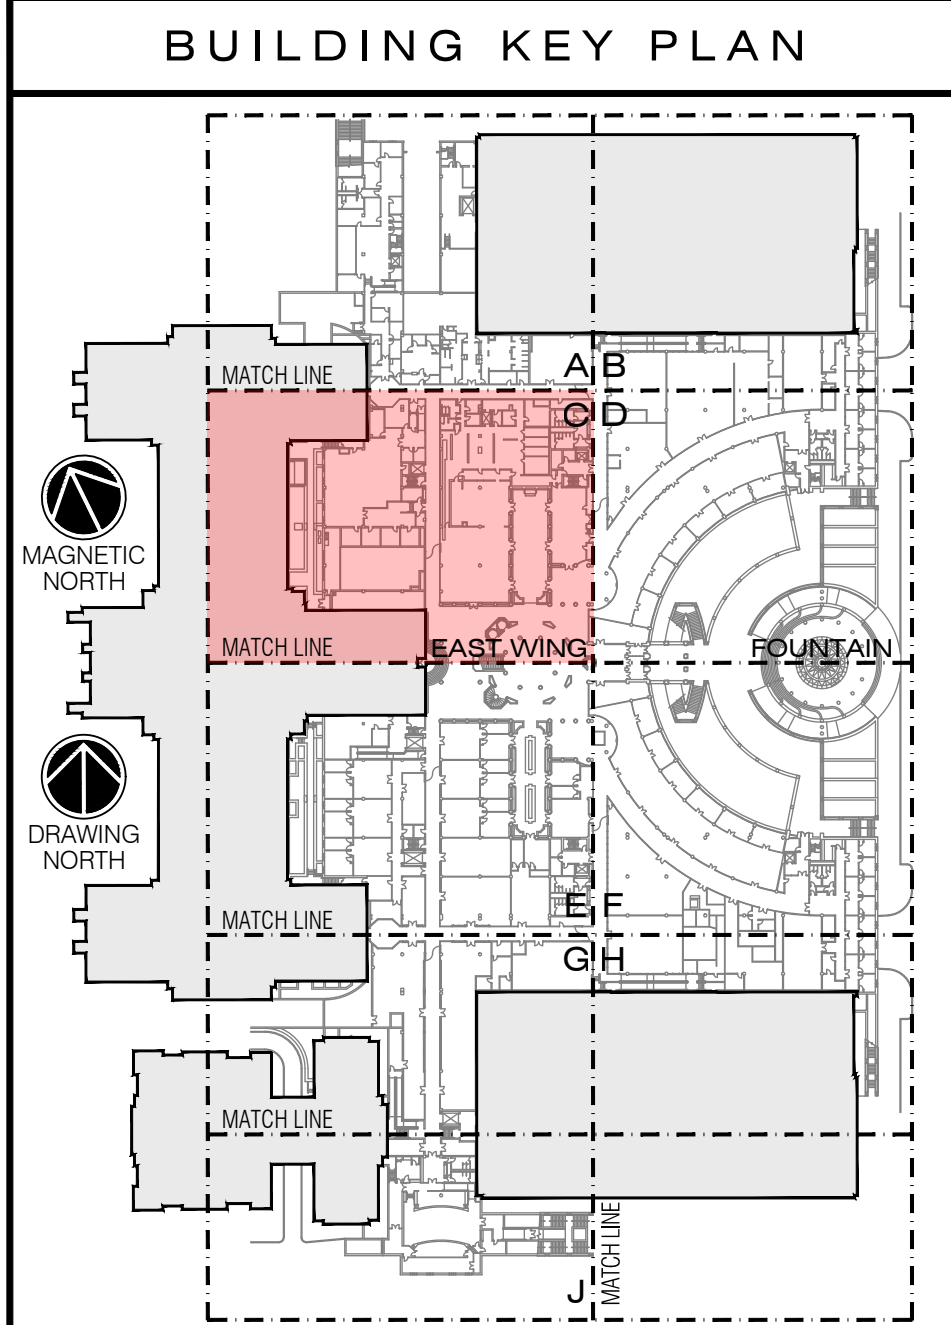


REFLECTED CEILING LEGEND
EXISTING 30"x60" CEILING PANEL & SUSPENSION GRID TO BE DEMOLISHED BY .1 GENERAL CONTRACTOR
NEW 24"x48" CEILING PANEL & SUSPENSION GRID TO BE PROVIDED BY .1 CONTRACTOR
NEW GWB & METALL. FRAMING SOFFIT/BULKHEAD TO BE PROVIDED BY .1 CONTRACTOR
EXISTING HVAC LINEAR DIFFUSER TO BE DEMOLISHED BY .1 GENERAL CONTRACTOR
NEW HVAC LINEAR DIFFUSER TO BE PROVIDED BY .1 GENERAL CONTRACTOR
NEW HVAC DUCTS, RISERS, ETC. TO BE PROVIDED BY .1 GENERAL CONTRACTOR
EXISTING SPRINKLER HEAD TO REMAIN
(D) EXISTING SPRINKLER HEAD TO BE REMOVED BY .3 PLUMBING CONTRACTOR
(N) NEW EXTENDED COVERAGE SPRINKLER HEAD TO BE PROVIDED BY .3 PLUMBING CONTRACTOR
EXISTING INDIRECT LIGHT FIXTURE TO BE REMOVED BY .1 GENERAL CONTRACTOR
(N) NEW 24"x48" RECESSED LED PANEL LIGHT FIXTURE TO BE PROVIDED BY .4 ELECTRICAL CONTRACTOR
(FA) EXISTING FIRE ALARM STROBE TO REMAIN
(S) EXISTING SENSOR TO REMAIN

VITETTA PROJECT 4645.0000	© 2024 VITETTA
ALL DIMENSIONS MUST BE VERIFIED BY THE CONTRACTOR AND THE ARCHITECT NOTIFIED OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE CONSTRUCTION. DO NOT SCALE THIS DRAWING.	

19	20
17	18
15	16
13	14
11	12
09	10
07	08
05	06
03	04
01	02

No.	DESCRIPTION	No.	DESCRIPTION
-----	-------------	-----	-------------

AS-BUILT REVISIONS



VITETTA Professional's Signature Consultant Professional's Signature Date

VITETTA
ARCHITECTURE | ENGINEERING | PLANNING
NOTHING PRESERVATION
645 NORTH 12TH STREET • SUITE 100
LEMOYNE • PENNSYLVANIA • 17043

COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF GENERAL SERVICES
HARRISBURG, PENNSYLVANIA

DGS PROJECT NUMBER

C-0948-0101 PHASE 001

CAPITOL EAST WING
REPLACEMENT OF ESCALATORS WITH ELEVATOR
HVAC DIFFUSERS & CAFETERIA UPGRADES

HARRISBURG, DAUPHIN COUNTY, PENNSYLVANIA

CONCOURSE - AREA 'C'
CAFETERIA LIGHTING
DEMOLITION & RENOVATION

DRAWN BY J. JOLIN DATE 01.04.2024 DRAWING NUMBER

CHECKED BY D. VOZDZAK SCALE 1/8" = 1'-0" P/FP213

DRAWING IS INTENDED FOR COLOR PRINTING