




THE HVAC CONTRACTOR WILL BE RESPONSIBLE TO FOLLOW THE PROJECT PHASING SCHEDULE AND REMOVE SYSTEM COMPONENTS FROM AREAS OF THE PROJECT THAT ARE NO LONGER OCCUPIED AND ARE WITHIN THE CURRENT PHASING LIMITATIONS.

THE HVAC CONTRACTOR WILL NEED TO PROVIDE ALL REQUIRED ISOLATION VALVES AND TEMPORARILY HVAC CONNECTIONS NECESSARY TO KEEP THE EXISTING HEATING/COOLING SYSTEMS FULLY OPERATIONAL WITHIN THE OCCUPIED PORTIONS OF THE BUILDING THROUGHOUT THE ENTIRE LENGTH OF THE PROJECT.

1. REFER TO DRAWING H-4 FOR HVAC GENERAL PROJECT NOTES.
2. PROVIDE REQUIRED SERVICE CLEARANCE FOR ALL HVAC UNITS AS RECOMMENDED BY THE EQUIPMENT MANUFACTURER.
3. THE HVAC CONTRACTOR IS RESPONSIBLE FOR ALL CUTTING AND PATCHING REQUIRED TO COMPLETE THE INDICATED WORK.
4. THE HVAC CONTRACTOR IS RESPONSIBLE FOR ALL EXCAVATION AND BACKFILLING NOT INDICATED TO BE PROVIDED BY THE OWNER. CONTRACTOR ELSEWHERE IN THE DOCUMENTS THAT IS REQUIRED TO COMPLETE ALL INDICATED HVAC WORK.
5. REFER TO ARCHITECTURAL REFLECTED CEILING PLANS FOR EXACT LOCATIONS OF HVAC CEILING OUTLETS AND OTHER CEILING MOUNTED DEVICES. ANY CEILING REMOVAL REQUIRED FOR WORK TO BE COMPLETED UNDER THIS CONTRACT, THAT IS NOT INDICATED ON THE ARCHITECTURAL PLANS, SHALL BE THE RESPONSIBILITY OF THIS CONTRACTOR. ALL CEILING REMOVALS SHALL BE CONTROLLED BY THE ARCHITECT AND/OR REPAIRED BY THE ARCHITECT AS PER SPECIFICATIONS.
6. HVAC CONTRACTOR SHALL PROVIDE MAINTAINING AIR VENTS AT ALL PIPING RUNS OUTS TO THE BUILDING. PROVIDE HOT WATER SYSTEM AND CHILLED WATER SYSTEM PIPING, TYPICAL THROUGHOUT THE ENTIRE PROJECT.
7. OTHER THAN CORRIDORS, ALL OVERHEAD HVAC SYSTEM PIPING MUST BE ROUTED EITHER UP IN BETWEEN BARS JUST OR THROUGH BAR JUST BEHIND WALLS THEREFORE NOTED.
8. PROVIDE ALL REQUIRED TEMPORARY PIPING CONNECTIONS NEEDED TO MAINTAIN DUAL TEMPERATURE CONTROL OF THE WATER AND HEATING SYSTEM PIPING LOOPS ACTIVE UNTIL ALL PHASES OF CONSTRUCTION ARE COMPLETE.
9. WHERE PIPING CONNECTIONS ARE TEMPORARILY BEING MADE TO EXISTING SYSTEM MAINS, REMOVE EXISTING PIPE INSULATION FROM AREA BEING TAPPED, COMPLETE PIPING CONNECTION THEN RE-INSULATE. PIPING PER REQUIREMENTS LISTED IN SPECIFICATIONS.
10. PRIOR TO COMPLETION OF FINAL PHASE OF CONSTRUCTION, ALL TEMPORARY PIPING CONNECTIONS, ASSOCIATED VALVES, HANGERS AND SUPPORTS MUST BE COMPLETELY REMOVED.

- 1 PROVIDE ISOLATION VALVES, STRAINER, CONTROL VALVE AND ALL REQUIRED CONTROLS AND WIRING NEEDED TO RECONNECT EXISTING TERMINAL HEATING EQUIPMENT TO BMS. RE-INSULATE PIPING AS INDICATED IN SPECIFICATIONS. RE-INSTALL EXISTING REFINISHED TERMINAL HEATING EQUIPMENT FRONT COVER PANEL THAT WAS REMOVED AND REFINISHED EARLIER.
- 2 PROVIDE ISOLATION VALVES, STRAINER, CONTROL VALVE AND ALL REQUIRED CONTROLS AND WIRING NEEDED TO RECONNECT EXISTING UNIT HEATER TO BMS. RE-INSULATE PIPING AS INDICATED IN SPECIFICATIONS.

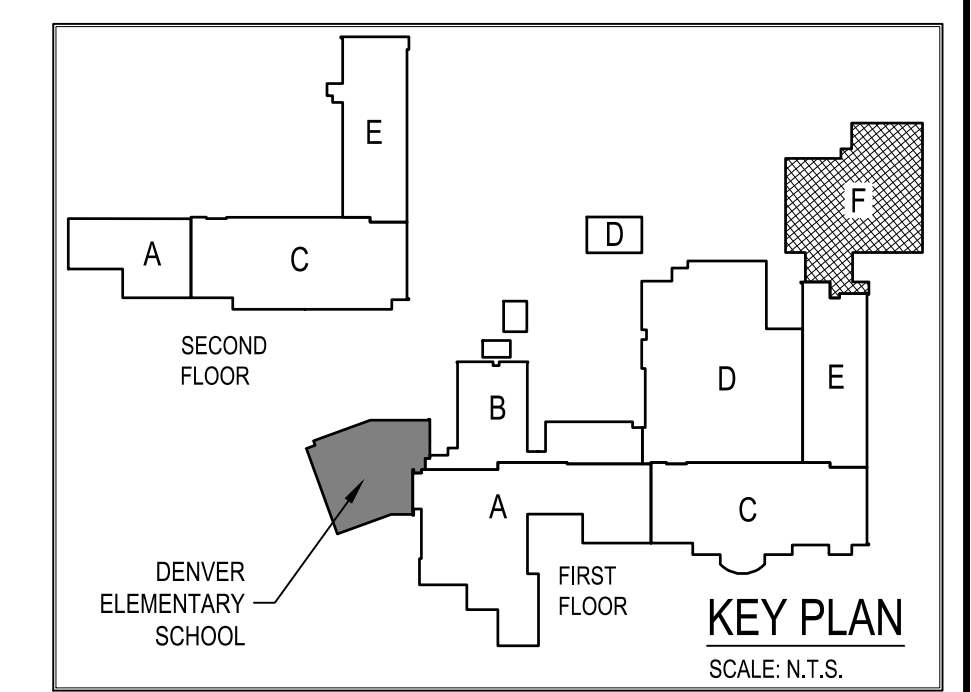

DIMENSIONS AND EXISTING CONDITIONS
shall be CHECKED AND VERIFIED
by the CONTRACTOR at the SITE.

OB NO.: 23001.00

DRAWN BY: RLC

DATE: 04.12.24

H-F2