




1
56.2
POINT LOAD JOIST REINFORCING
3/4" = 1'-0"



2
56.2
FRMG @ ROOF EQUIP CURBS & OPNGS
3/4" = 1'-0"





3
56.2
STEEL BEAM/CMU WALL
3/4" = 1'-0"




4
56.2
TYPICAL BEAM/COLUMN EXTENSION AT JOIST/OUTRIGGER
3/4" = 1'-0"


BEARING PL SCHEDULE			
MARK	'A'	'B'	'T'
PL1	7 1/2"	8"	1 1/2"




6
56.2
STEEL BEAM/CMU WALL BEARING DETAILS
3/4" = 1'-0"














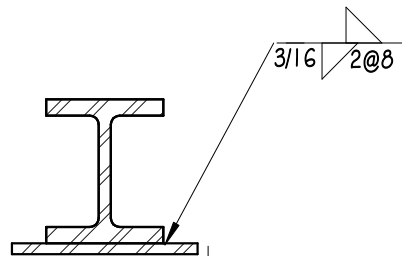
5
56.2
NON-LOAD BEARING CMU WALL BRACING DETAILS
3/4" = 1'-0"



7
56.2
MASONRY SHEARWALL DETAILS
3/4" = 1'-0"



8
56.2
EXTERIOR TUBE LINTEL IN 8" CMU DETAIL
3/4" = 1'-0"

LINTEL SCHEDULE				
SPAN \ WIDTH		8" CMU INTERIOR	8" CMU EXTERIOR	12" CMU EXTERIOR
UP TO 4'-4"		 (2) 4x8 w/ 2#4 T & B	H558x4x5/16 + 3/8" PLATE CONT 	(2) L5x3 1/2x5/16 + L6x4x5/16 
GREATER 4'-4" TO 6'-8"		 (2) 4x8 w/ 2#5 T & B	H558x4x5/16 + 3/8" PLATE CONT 	(2) L6x3 1/2x3/8 + L6x4x3/8 
GREATER 6'-8" TO 12'-0"		 W8x24	H558x6x1/2 + 3/8" PLATE CONT 	N/A
GREATER 12'-0" TO 16'-0"		 W8x28	H5512x6x1/2 + 3/8" PLATE CONT 	N/A
<p>NOTES:</p> <ol style="list-style-type: none">1. ALL NON-STEEL LINTELS SHALL BE PRECAST CONCRETE, F_c = 5000 psi.2. PRECAST LINTEL SIZES INDICATED ARE NOMINAL.3. ALL LINTELS SHALL BEAR 8" MIN. EACH END UNO. GROUT SOLID 3 COURSES MIN. BELOW BEARING.4. EXTERIOR LINTELS SHALL BE HOT-DIPPED GALVANIZED.5. COORDINATE LINTEL LOCATIONS WITH ARCHITECTURAL, M/E/P DRAWINGS.6. SPAN LENGTH - MASONRY OPENING DIMENSION.7. GALVANIZE ALL STEEL LINTELS AND PLATES @ EXTERIOR WALLS.8. PROVIDE 1/2" DIA x 4" STUD ANCHORS @ 2'-8" o/c ON TOP FLANGE OF ALL STEEL WIDE FLANGE LINTELS.9. FOR EXTERIOR WALLS WITHOUT MASONRY VENEER - USE INTERIOR LINTEL SCHEDULE.10. PROVIDE ANCHOR BOLTS WHERE SHOWN THUS  PER TYPICAL LINTEL DETAIL.11. WHERE LINTELS FOR TWO MASONRY OPNGS GREATER THAN 7 FT HAVE LESS THAN 1'-4" BETWEEN OPENINGS, PROVIDE AN HSS 4X4X1/4" POST BETWEEN THE TWO OPENINGS FROM UNDERSIDE OF OPENING TO UNDERSIDE OF LINTEL				
 <p>TYPICAL WELD - PLATE TO BEAM</p>				

